


\* CONCRETE BLOCKING:  
 NOT REQUIRED WHEN ANCHORING  
 FITTINGS ARE USED IN ALL  
 APPROPRIATE SECTIONS OF  
 HYDRANT INSTALLATION.

NOTE: CARE SHALL BE EXERCISED TO KEEP HYDRANT DRAIN OPENING FREE TO OPERATE.  
 TYPE OF HYDRANT SHALL MEET THE REQUIREMENTS OF SPECS. 803.  
 PIPE SECTION BETWEEN VALVE & HYDRANT SHALL BE ONE ANCHORING  
 PIPE - CLOW F-1216 OR APPROVED EQUAL-36" MINIMUM.  
 HYDRANT TO BE PAINTED "CHROME YELLOW"

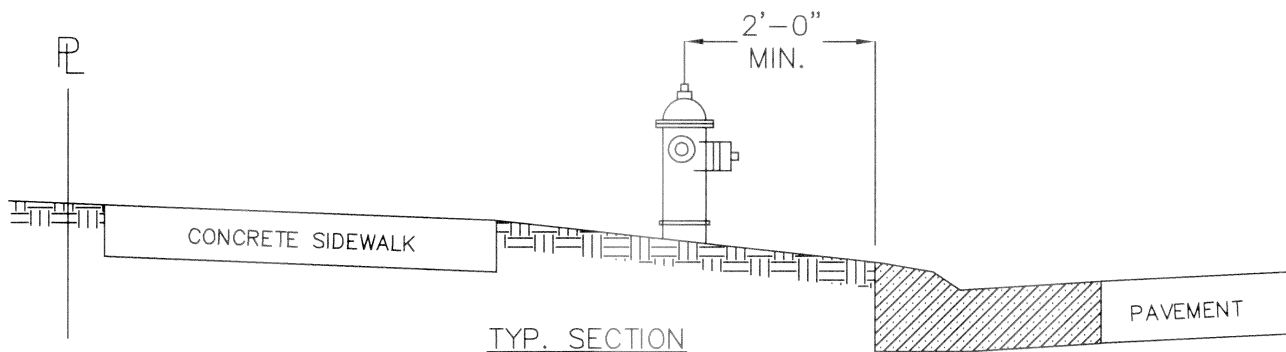

CITY OF NEWARK, OHIO  
 DIVISION OF ENGINEERING

STANDARD DRAWING 800-5  
 HYDRANT DETAIL

9-91  
 PIPES  
 REVISED  
 5-96 KELLEY  
 2-96 KELLEY  
 2-06 KELLEY