


\* MULTIPLE OUTSIDE SHUT OFF VALVES  
 ARE REQUIRED TO BE INSTALLED ON PRIVATE  
 PROPERTY, WITH MULTIPLE METERS (SAME BLDG)  
 SEE STANDARD DRAWING 800-WS3A

NOTE: WATERMAIN TO BE IN STREET AS SHOWN

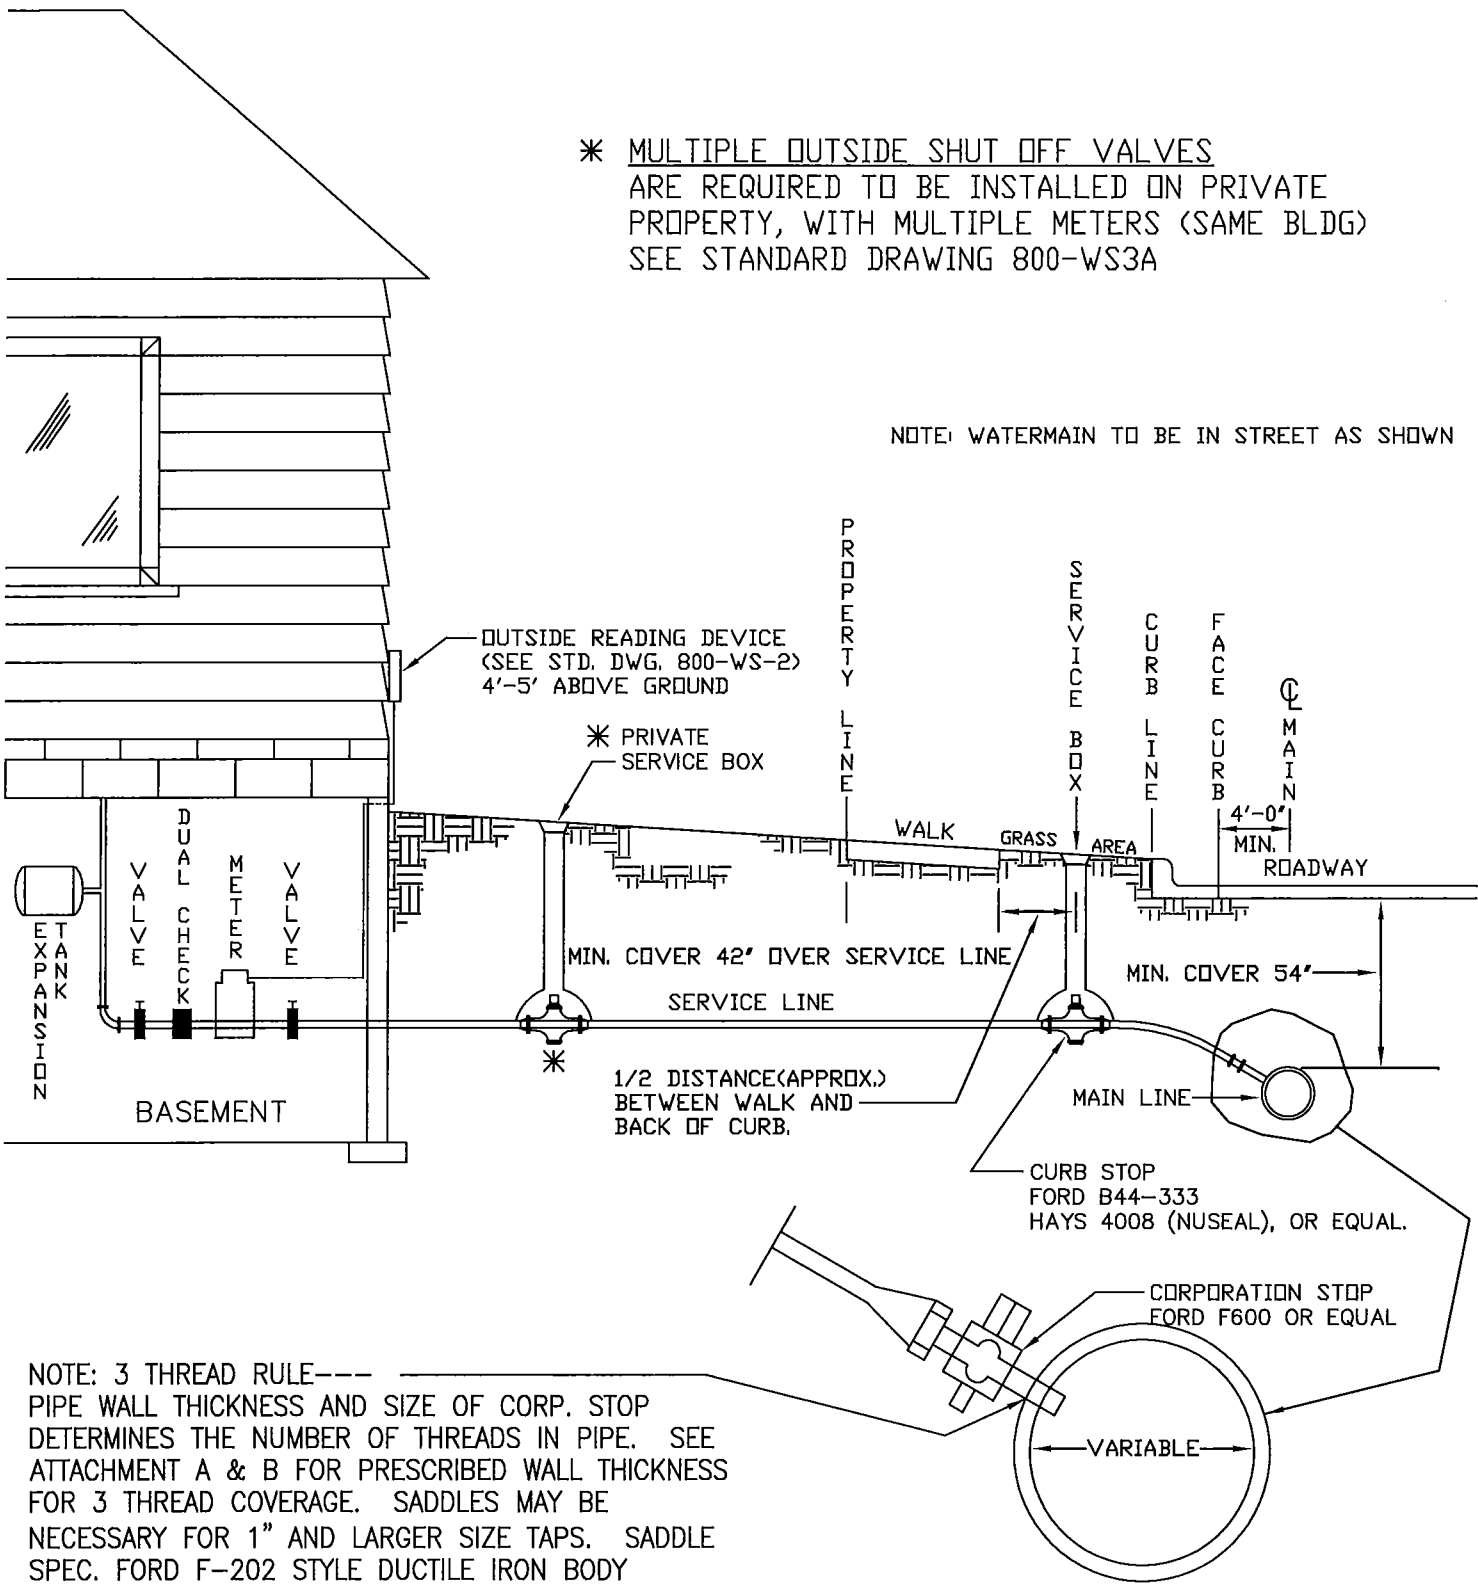

NOTE: 3 THREAD RULE---  
 PIPE WALL THICKNESS AND SIZE OF CORP. STOP  
 DETERMINES THE NUMBER OF THREADS IN PIPE. SEE  
 ATTACHMENT A & B FOR PRESCRIBED WALL THICKNESS  
 FOR 3 THREAD COVERAGE. SADDLES MAY BE  
 NECESSARY FOR 1" AND LARGER SIZE TAPS. SADDLE  
 SPEC. FORD F-202 STYLE DUCTILE IRON BODY  
 W/STEEL, ZINC COATED STRAPS OR APPROVED EQUAL.

NOTE: CORP. STOP CAN BE  
 PLACED AT 10:00 OR 2:00

CITY OF NEWARK, OHIO  
 DIVISION OF ENGINEERING

STANDARD DRAWING 800-WS-3  
 WATER SERVICE INSTALLATION

6-91  
 PIPES  
 REVISED  
 6-94 KELLEY  
 12-94 KELLEY  
 5-96 KELLEY  
 7-97 KELLEY  
 2-98 KELLEY  
 2-01 KELLEY  
 9-02 KELLEY  
 4-06 KELLEY  
 10-17 KELLEY