


# METER SETTING

## (1 1/2"–6" WATER METERS)

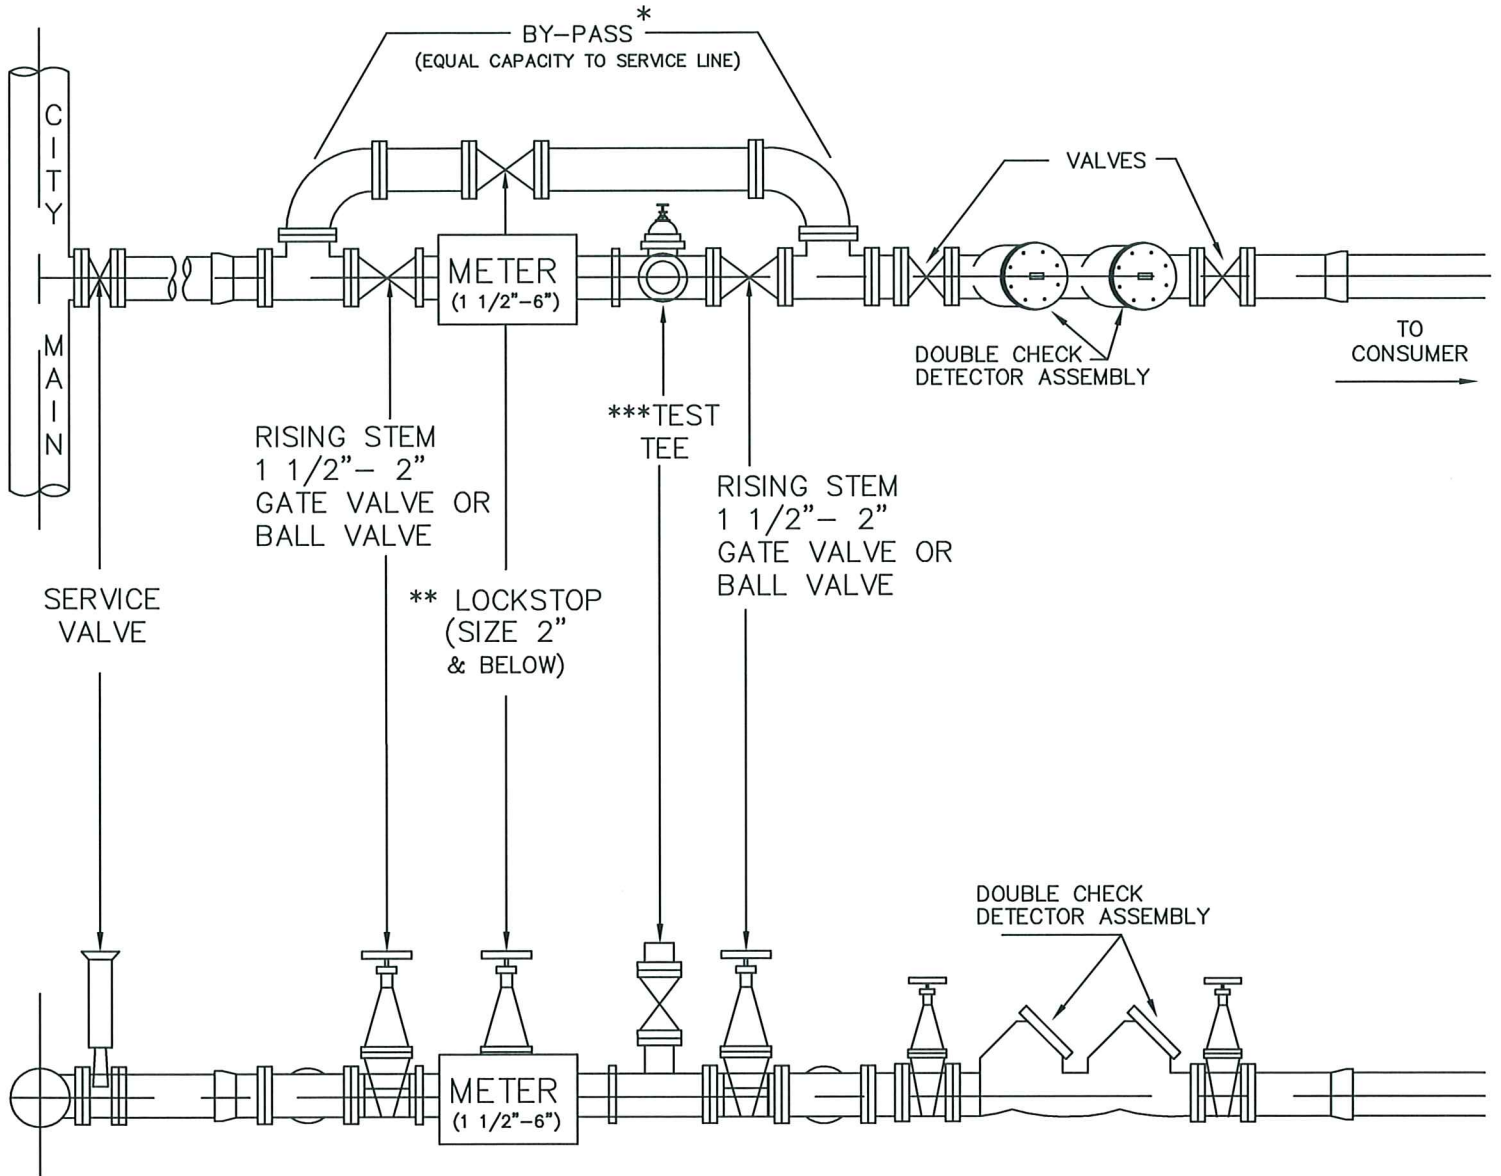

**NOTES:**

\* SIZE OF THE BY-PASS LINE MUST MEET EMERGENCY WATER REQUIREMENTS.

\*\* LOCKSTOP MUST BE PURCHASED THROUGH THE NEWARK WATER DEPT. FOR THE BY-PASS VALVE (SIZES 2" AND BELOW).

\*\*\* FOR TURBO METERS, SIZES 3" OR LARGER, THE TEST TEE IS TO BE FULL SIZE WITH REDUCING FLANGE TO 2" NIPPLE AND 2" LOCKSTOP (PURCHASED THROUGH THE NEWARK WATER DEPT.). TEST TEE MUST BE LOCATED A MINIMUM OF 2 PIPE DIAMETERS DOWNSTREAM OF THE TURBO-METER.

SIZE	COMPANION FLANGE	METER TYPE		
		DISPLACEMENT	COMPOUND	TURBINE
1 1/2"	1 1/8"	13"	---	---
2"	1 1/4"	17"	17"	10"
3"	1 1/4"	---	17"	12"
4"	1 5/16"	---	24"	14"
6"	1 7/16"	---	24"	18"
TEST TEE		REQUIRED	NOT REQUIRED	REQUIRED

1-94  
KELLEY

CITY OF NEWARK, OHIO  
DIVISION OF ENGINEERING

STANDARD DRAWING 800-WS-5  
METER SETTING-1 1/2"-6"

REVISED  
12-94 KELLEY  
5-96 KELLEY  
2-98 KELLEY  
10-00 KELLEY  
4-06 KELLEY  
2-07 KELLEY