


***TEST TEE TO BE FULL SIZE WITH REDUCING FLANGE TO 2" NIPPLE AND 2" LOCKSTOP (PURCHASED THRU THE NEWARK WATER DEPT.). TEST TEE MUST BE LOCATED A MINIMUM OF 2 PIPE DIAMETERS DOWNSTREAM OF THE TURBO-METER.

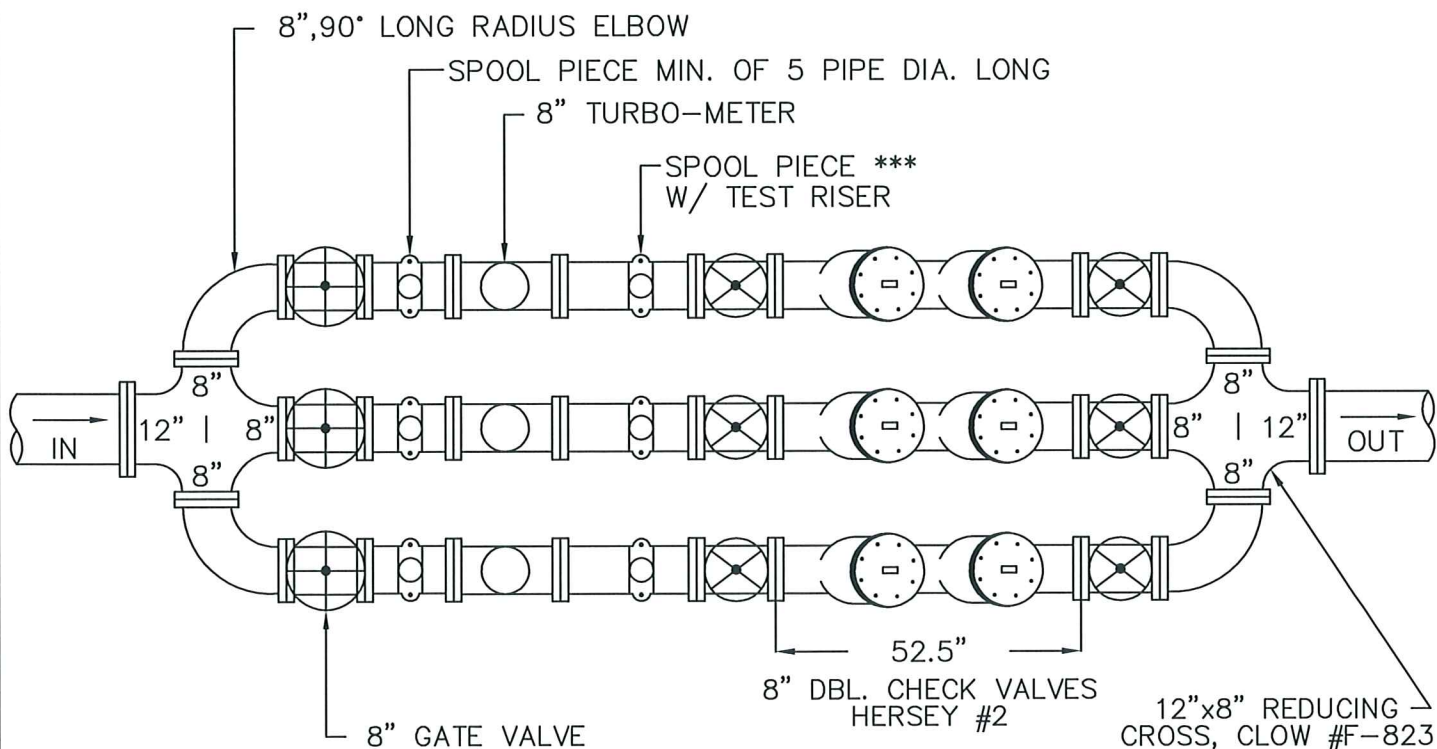

5-96 KELLEY

CITY OF NEWARK, OHIO
DIVISION OF ENGINEERING

STANDARD DRAWING 800-WS-5B

METER MANIFOLDS

REVISED
2-98 KELLEY
4-08 KELLEY