


ALL PIPE TO BE  
DUCTILE IRON CLASS 52  
W/ CAST IRON OR

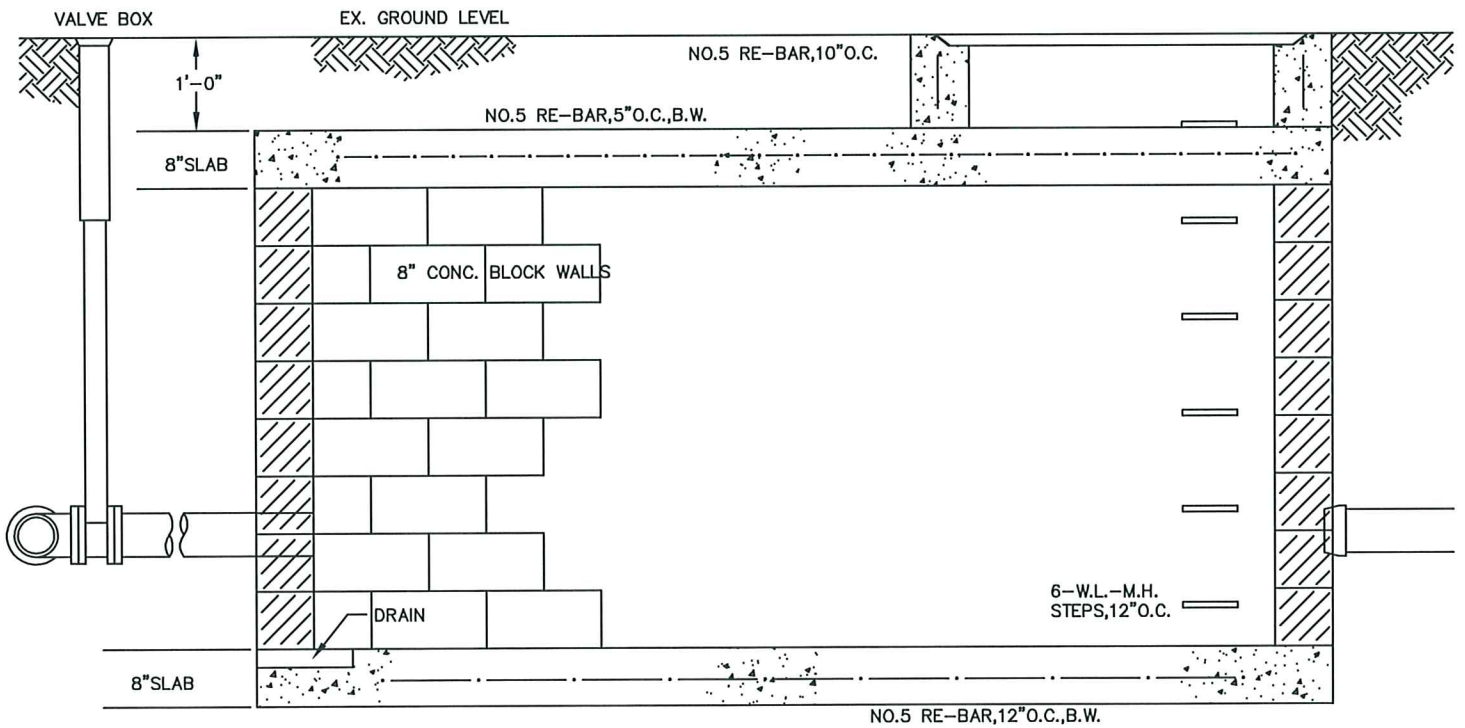

- \* REF. DRAWING 800-WS-5A FOR DUEL METER SETTINGS (DOMESTIC & FIRE)
- \* REF. DRAWING 800-WS-5 FOR STANDARD METER SETTING (1 1/2 & ABOVE)

5-06  
KELLEY

CITY OF NEWARK, OHIO  
DIVISION OF ENGINEERING

STANDARD DRAWING 800-WS-6B  
METER PIT-DUAL METER SETTING

REVISED  
5-06 KELLEY