


THIS DRAWING APPLIES FOR PIPE SIZES UP TO 27".

UNLESS OTHERWISE SPECIFIED
MANHOLE CASTINGS TO BE
NEENAH R-1723 OR R-1642
OR EAST JORDAN 1047
OR APPROVED EQUAL AND
ANCHORED TO MANHOLE.

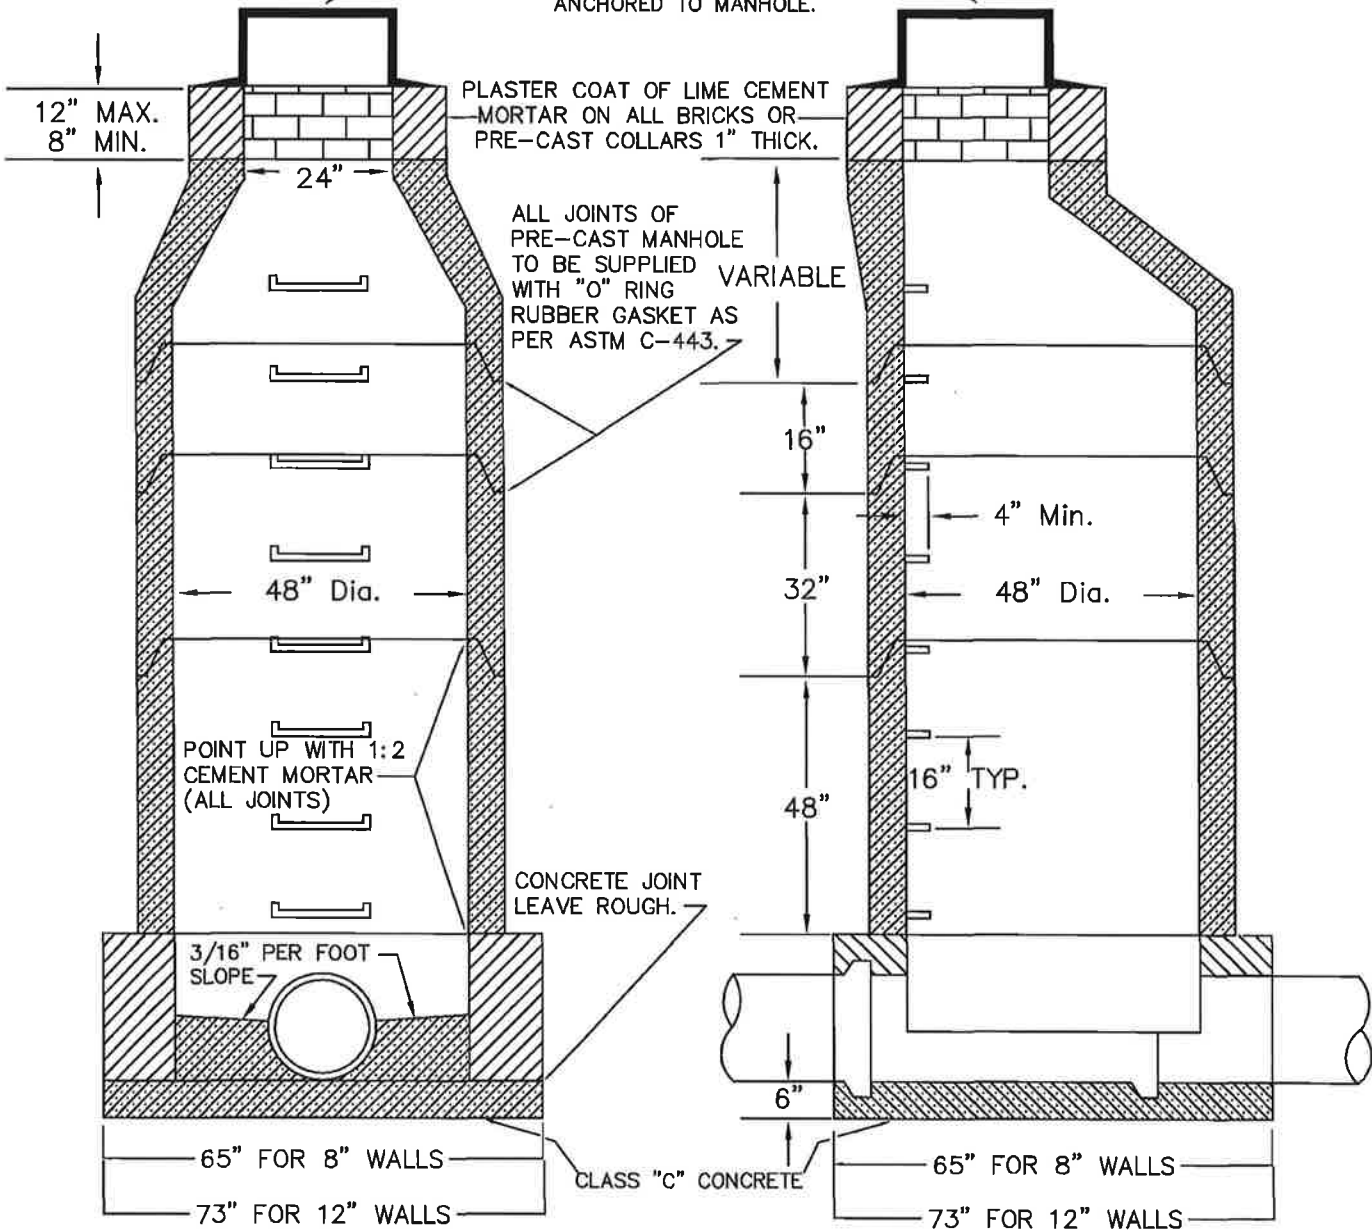

NOTE: ALL MANHOLES SHALL BE CONSTRUCTED TO THE ELEVATION OF THE PROPOSED STREET GRADE OR TO THE PRESENT GROUND ELEVATION, WHICHEVER IS HIGHER, UNLESS OTHERWISE ORDERED.

MANHOLE BARREL SECTIONS CAN BE MADE IN 16", 32", 48" AND 64" LAYING LENGTHS TO SUIT FIELD CONDITIONS. THESE SECTIONS SHALL BE USED IN SUCH COMBINATIONS AS WILL BE NECESSARY TO FIT EACH LOCATION.

MANHOLE STEPS TO BE NEENAH CAST IRON CAT. NO. R-1980-E OR FORGED ALUMINUM ALLOY PER ASTM B221 OR REINFORCED PROPYLENE PLASTIC, PER 711.31 ALL MEETING O.S.H.A. REQUIREMENTS.

CITY OF NEWARK, OHIO
DIVISION OF ENGINEERING

STANDARD DRAWING 900-7
STANDARD SAMPLING MANHOLES

7-91
PIPES
REVISED
5-96 KELLEY
2-98 KELLEY
2-08 KELLEY